


STEEL "C" CHANNEL
(EXTERIOR COATING RECOMMENDED)

STEEL "UNISTRUT" CHANNEL
(EXTERIOR COATING RECOMMENDED)




CABLE LENGTH NOT TO EXCEED
2 METRES OF CABLE IN EITHER
DIRECTION TO AND FROM THE
CATHODIC ISOLATOR® MODEL
SSP-ATEX

INSULATED STRANDED COPPER CABLE
(ICCC RECOMMENDS TWO (2)
CABLES PER TERMINAL)

CABLE GLANDS
(ICCC RECOMMENDS ATEX
CERTIFIED CABLE GLANDS)

TYPICAL CABLE CONNECTION
(ICCC RECOMMENDS THE
END USER TO COAT THE
CONNECTION)

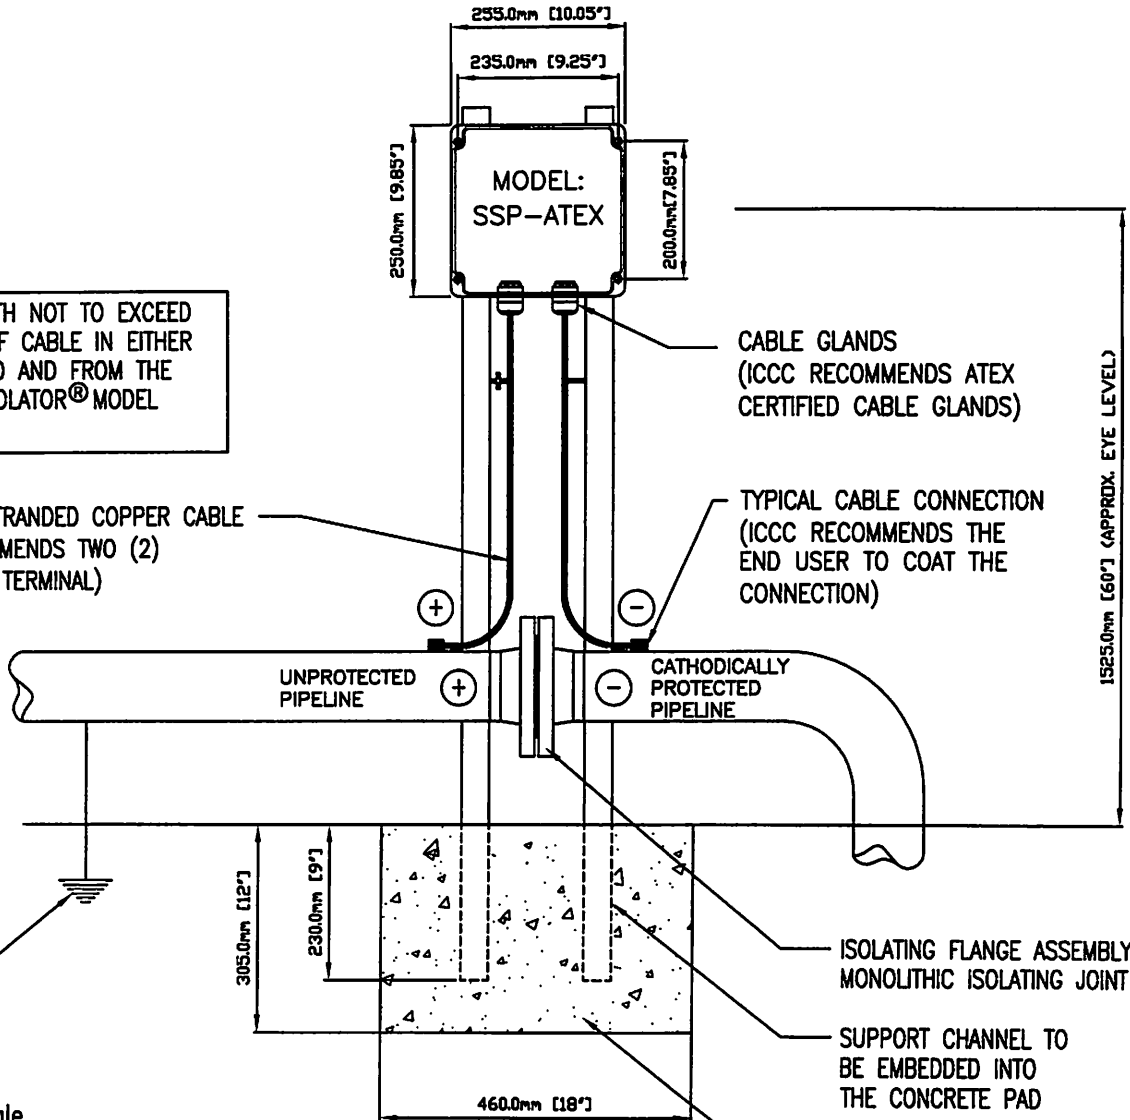

ELECTRICAL UTILITIES
GROUNDING NETWORK

ISOLATING FLANGE ASSEMBLY OR
MONOLITHIC ISOLATING JOINT

SUPPORT CHANNEL TO
BE EMBEDDED INTO
THE CONCRETE PAD

INSTALL CONCRETE PAD ON SITE

NOTES:

- 1) Not drawn to scale.
- 2) While published statements are believed to be accurate, they are offered as suggestions only. Any use thereof is at the user's independent discretion.

TYPICAL INSTALLATION OF
RUSTROL® CATHODIC ISOLATOR® SYSTEM MODEL: SSP-ATEX

no.	date	by	revision	chk'd by	date
0	APR 20/2007	M.A.	ISSUED FOR REVIEW	<i>[Signature]</i>	APR 20/2007
					designed W.B.R.
					detailed M.A.
					checked W.B.R.

**INTERPROVINCIAL
CORROSION CONTROL
COMPANY LIMITED**

930 Sheldon Court
Burlington Ontario Canada
Ph: (905) 634-7751 Fax: (905) 333-4313
Copyright 2007

title
TYPICAL INSTALLATION OF
RUSTROL® CATHODIC ISOLATOR®
SYSTEM MODEL: SSP-ATEX

drawing no. rev.
SSP-04 0