



CABLE LENGTH NOT TO EXCEED 2 METRES OF CABLE IN EITHER DIRECTION TO AND FROM THE CATHODIC ISOLATOR® MODEL SSP-ETL

INSULATED STRANDED COPPER CABLE (ICCC RECOMMENDS TWO (2) CABLES PER TERMINAL)

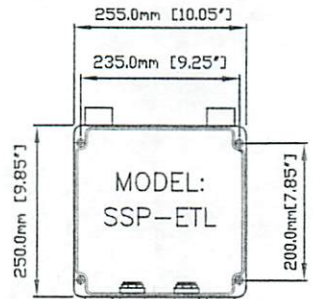

CABLE GLANDS (ICCC RECOMMENDS CERTIFIED CABLE GLANDS)

TYPICAL CABLE CONNECTION (ICCC RECOMMENDS THE END USER TO COAT THE CONNECTION)

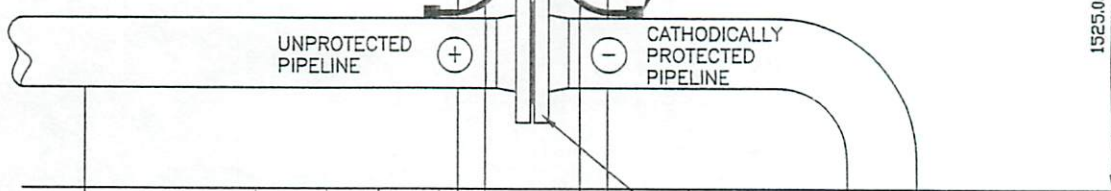

ELECTRICAL UTILITIES GROUNDING NETWORK

ISOLATING FLANGE ASSEMBLY OR MONOLITHIC ISOLATING JOINT

SUPPORT CHANNEL TO BE EMBEDDED INTO THE CONCRETE PAD

INSTALL CONCRETE PAD ON SITE

NOTES:

- 1) Not drawn to scale.
- 2) While published statements are believed to be accurate, they are offered as suggestions only. Any use thereof is at the user's independent discretion.

TYPICAL INSTALLATION OF RUSTROL® CATHODIC ISOLATOR® SYSTEM MODEL: SSP-ETL

| no. | date | by | revision | chk'd by | date |
|-----|------------|------|-------------------|-------------|------------|
| 0 | FEB 9/2012 | H.O. | ISSUED FOR REVIEW | [Signature] | FEB 9/2012 |
| | | | | | |
| | | | | | |
| | | | | | |

INTERPROVINCIAL CORROSION CONTROL COMPANY LIMITED
 930 Sheldon Court
 Burlington Ontario Canada
 Ph: (905) 634-7751 Fax: (905) 333-4313
 Copyright 2012

| title | drawing no. | rev. |
|---|-------------|------|
| TYPICAL INSTALLATION OF RUSTROL® CATHODIC ISOLATOR® SYSTEM MODEL: SSP-ETL | SSP-08 | 0 |