


TYPICAL SSP-ETL ENCLOSURE:

- UL LISTED ENCLOSURE
- FIBREGLASS REINFORCED POLYESTER
- NEMA 4, 4X, 6P (CERTIFIED); EQUIVALENT TO IP68 CRITERIA
- TYPICAL OVERALL DIMENSIONS FOR STANDARD RUSTROL® MODEL SSP-ETL
- DIMENSIONS ARE SUBJECT TO CHANGE, AND ARE MODEL SPECIFIC.

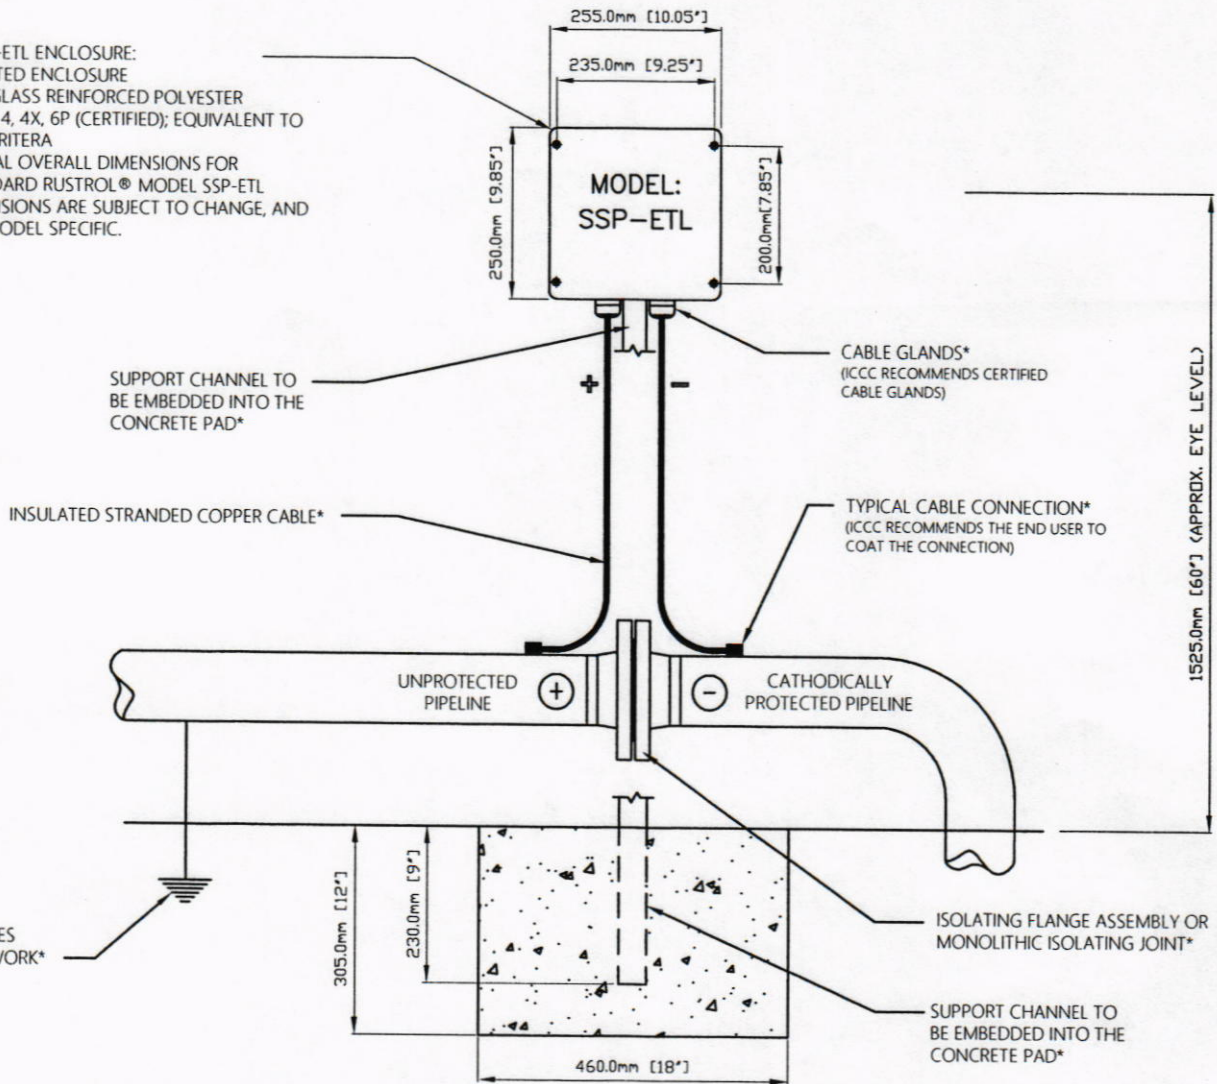

ELECTRICAL UTILITIES GROUNDING NETWORK*

NOTES:

- 1) NOT DRAWN TO SCALE
- 2) NOMINAL DIMENSIONS
- 3) ALL DIMENSIONS ARE APPROXIMATE.
- 4) ALL DIMENSIONS ARE SHOWN WITH BOTH METRIC & IMPERIAL UNITS AND ARE GOVERNED BY THE IMPERIAL MEASUREMENTS AS SHOWN.
- 5) TYPICAL INSTALLATION ONLY. VARIATIONS ARE COMMON BASED ON THE SITE REQUIREMENTS. ALL NOTED (*) DETAILS ARE PROVIDED AS SUGGESTIONS ONLY, AND ARE TO BE PROVIDED BY OTHERS. ALL NOTED (*) DETAILS ARE NOT INCLUDED WITH RUSTROL® PRODUCTS.
- 6) CABLE LENGTH IS RECOMMENDED NOT TO EXCEED 2 METRES (6 FT) IN EITHER DIRECTION TO AND FROM THE CATHODIC ISOLATOR® MODEL: SSP-ETL. ICCC RECOMMENDS TWO (2) CABLES PER TERMINAL
- 7) WHILE PUBLISHED STATEMENTS ARE BELIEVED TO BE ACCURATE, THEY ARE OFFERED AS SUGGESTIONS ONLY. ANY USE THEREOF IS AT THE USER'S INDEPENDENT DISCRETION.
- 8) THIS DRAWING REMAINS THE PROPERTY OF INTERPROVINCIAL CORROSION CONTROL COMPANY LTD

No.	Date	By	Revision	Chk'd By	Date
0	FEB 9/2012	H.O.	ISSUED FOR REVIEW		FEB 9/2012
1	SEPT 9/2015	H.O.	CHANGED TO CURRENT FORMAT	<i>AE</i>	
					Designed W.B.R.
					Detailed H.O.
					Checked A.E.

INTERPROVINCIAL CORROSION CONTROL COMPANY LIMITED
 930 Sheldon Court
 Burlington Ontario Canada
 Ph: (905) 634-7751 Fax: (905) 333-4313
 www.Rustrol.com
 Copyright 2015

Project
TYPICAL INSTALLATION OF RUSTROL® CATHODIC ISOLATOR® MODEL: SSP-ETL
 Drawing No. **SSP-08** Rev. **1**