


- TYPICAL SSP-ETL ENCLOSURE:
- UL LISTED ENCLOSURE
 - FIBREGLASS REINFORCED POLYESTER
 - NEMA 4, 4X, 6P (CERTIFIED); EQUIVALENT TO IP68 CRITERIA
 - TYPICAL OVERALL DIMENSIONS FOR STANDARD RUSTROL® MODEL SSP-ETL
 - DIMENSIONS ARE SUBJECT TO CHANGE, AND ARE MODEL SPECIFIC.




SUPPORT CHANNEL TO BE EMBEDDED INTO THE CONCRETE PAD*

INSULATED STRANDED COPPER CABLE*

CABLE GLANDS*
(ICCC RECOMMENDS CERTIFIED CABLE GLANDS)

TYPICAL CABLE CONNECTION*
(ICCC RECOMMENDS THE END USER TO COAT THE CONNECTION)

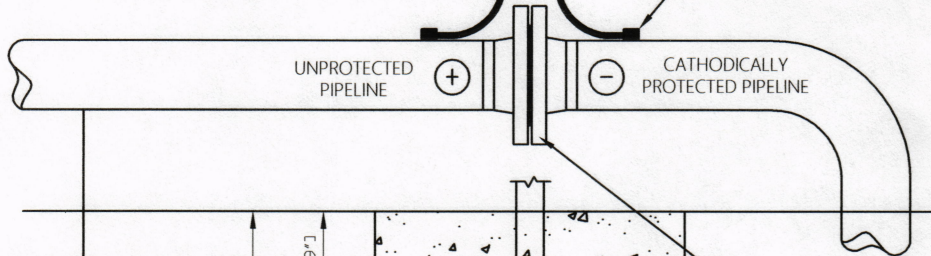

ELECTRICAL UTILITIES GROUNDING NETWORK*

305.0mm [12"]

230.0mm [9"]

460.0mm [18"]

ISOLATING FLANGE ASSEMBLY OR MONOLITHIC ISOLATING JOINT*

SUPPORT CHANNEL TO BE EMBEDDED INTO THE CONCRETE PAD*

NOTES:

- 1) NOT DRAWN TO SCALE.
- 2) NOMINAL DIMENSIONS, ALL DIMENSIONS ARE APPROXIMATE.
- 3) ALL DIMENSIONS ARE SHOWN WITH BOTH METRIC & IMPERIAL UNITS AND ARE GOVERNED BY THE IMPERIAL MEASUREMENTS AS SHOWN.
- 4) TYPICAL INSTALLATION ONLY. VARIATIONS ARE COMMON BASED ON THE SITE REQUIREMENTS. ALL NOTED (*) DETAILS ARE PROVIDED AS SUGGESTIONS ONLY, AND ARE TO BE PROVIDED BY OTHERS. ALL NOTED (*) DETAILS ARE NOT INCLUDED WITH RUSTROL® PRODUCTS.
- 5) CABLE LENGTH IS RECOMMENDED NOT TO EXCEED 2 METRES (6 FT) IN EITHER DIRECTION TO AND FROM THE CATHODIC ISOLATOR® MODEL: SSP-ETL. ICCC RECOMMENDS TWO (2) CABLES PER TERMINAL.
- 6) INSTALLATION IS RECOMMENDED TO BE UNDERTAKEN BY AN AUTHORIZED ELECTRICIAN/CONTRACTOR FAMILIAR WITH INSTALLATION CODES WITHIN THE JURISDICTION OF THE COUNTRY FOR WHICH THE RUSTROL® PRODUCT IS BEING INSTALLED WITHIN.
- 7) ICCC IS NOT LIABLE FOR DAMAGES CAUSED BY INCOMPATIBILITY OF ANY NON-RUSTROL® COMPONENT CONNECTED TO THE RUSTROL® SYSTEM.
- 8) WHILE PUBLISHED STATEMENTS ARE BELIEVED TO BE ACCURATE, THEY ARE OFFERED AS SUGGESTIONS ONLY. ANY USE THEREOF IS AT THE USER'S INDEPENDENT DISCRETION.
- 9) THIS DRAWING REMAINS THE PROPERTY OF INTERPROVINCIAL CORROSION CONTROL COMPANY LTD.

No.	Date	By	Revision	Chk'd By	Date
0	FEB 9/2012	HO	ISSUED FOR REVIEW		FEB 9/2012
1	SEPT 9/2015	HO	CHANGED TO CURRENT FORMAT		Designed WBR
2	MAY 23/2019	ST	UPDATED NOTES AND GENERIC DIMENSIONS		Detailed HO
3	MAR 10/2020	BC	UPDATED NOTES		Checked AE

**INTERPROVINCIAL
CORROSION CONTROL
COMPANY LIMITED**
930 Sheldon Court
Burlington Ontario Canada
Ph: (905) 634-7751 Fax: (905) 333-4313
www.Rustrol.com
Copyright 2020

Project TYPICAL INSTALLATION OF RUSTROL® CATHODIC ISOLATOR® MODEL: SSP-ETL	
Drawing No. SSP-08	Rev. 3